



产品认证证书

证书编号：CQC2018010307114216

申请人名称及地址

上海天逸电器有限公司
上海市松江区车墩镇北闵路 101 号第二、三幢

制造商名称及地址

上海天逸电器有限公司
上海市松江区车墩镇北闵路 101 号第二、三幢

生产企业名称及地址

德力西电气（芜湖）有限公司(V025026)
安徽省芜湖市芜湖机械工业园

产品名称和系列、规格、型号

塑料外壳式断路器

TYB2Z；详情见附件

产品标准和技术要求

GB/T14048.2-2008

认证模式

型式试验+获证后监督

上述产品符合 CQC11-462141-2019 认证规则的要求，特发此证。

发证日期：2020 年 07 月 10 日 有效期至：2023 年 04 月 18 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

经中国合格评定国家认可委员会认可 CNAS C001-P

主任：陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0261765



产品认证证书

附录

第 1 页 共 2 页

证书编号: CQC2018010307114216

纸号: 261765

TYB2Z;

额定冲击耐受电压(U_{imp}): 6kV;

额定绝缘电压(U_i): 1000V;

额定工作电压(U_e): DC125V, DC250V(1P 外形); DC250V, DC500V(2P 外形);

DC1000V(4P 外形);

额定电流(I_n): 1A, 2A, 3A, 4A, 6A, 10A, 16A, 20A, 25A, 32A, 40A, 50A, 63A;

过电流脱扣器类型: 热磁式;

额定运行短路分断能力(I_{cs}): 7.5kA(DC125V(1P 外形), DC250V(1P 外形), DC250V(2P 外

形), DC500V(2P 外形)); 6kA(DC1000V(4P 外形));

额定极限短路分断能力(I_{cu}): 10kA(DC125V(1P 外形), DC250V(1P 外形), DC250V(2P 外

形), DC500V(2P 外形)); 6kA(DC1000V(4P 外形));

使用类别: A;

适用隔离;

注: 此附录与证书同时使用时有效。

主任: 陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



产品认证证书


附录

第 2 页 共 2 页

证书编号: CQC2018010307114216

纸号: 261765

直流接线方式:

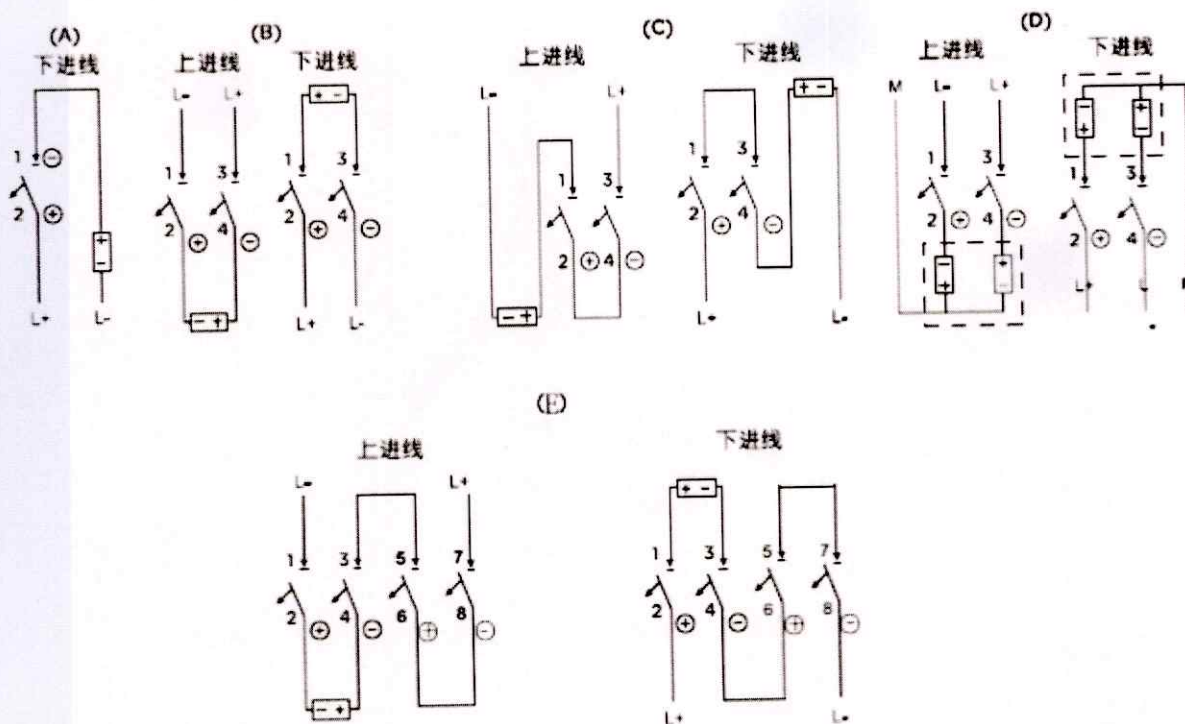

注: 此附录与证书同时使用时有效。

主任: 陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



PRODUCT CERTIFICATE

CERTIFICATE NO.: CQC2018010307114216

NAME AND ADDRESS OF THE APPLICANT

Shanghai TAYEE Electric.Co.,Ltd.
Building 2&3, No.101 Beimin Road, Chedun Town, Songjiang District, Shanghai City, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

Shanghai TAYEE Electric.Co.,Ltd.
Building 2&3, No.101 Beimin Road, Chedun Town, Songjiang District, Shanghai City, P.R.China

NAME AND ADDRESS OF THE FACTORY

DELIXI ELECTRIC (WUHU) LTD (V025026)
Wuhu Machinery Industrial Park, Wuhu City, Anhui Province, 241100, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

moulded case circuit breaker(MCCB)
TYB2Z; See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.2-2008

TYPE OF CERTIFICATION SCHEMES

Type testing+Follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462141-2019 .

Valid from: Jul.10,2020

Valid until: Apr.18,2023

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Accredited by China National Accreditation Service for Conformity Assessment CNAS C001-P

President: _____

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China
<http://www.cqc.com.cn>

C 0261765